


WASHINGTON STATE APPROVED
DOUBLE CHECK VALVE ASSEMBLY.

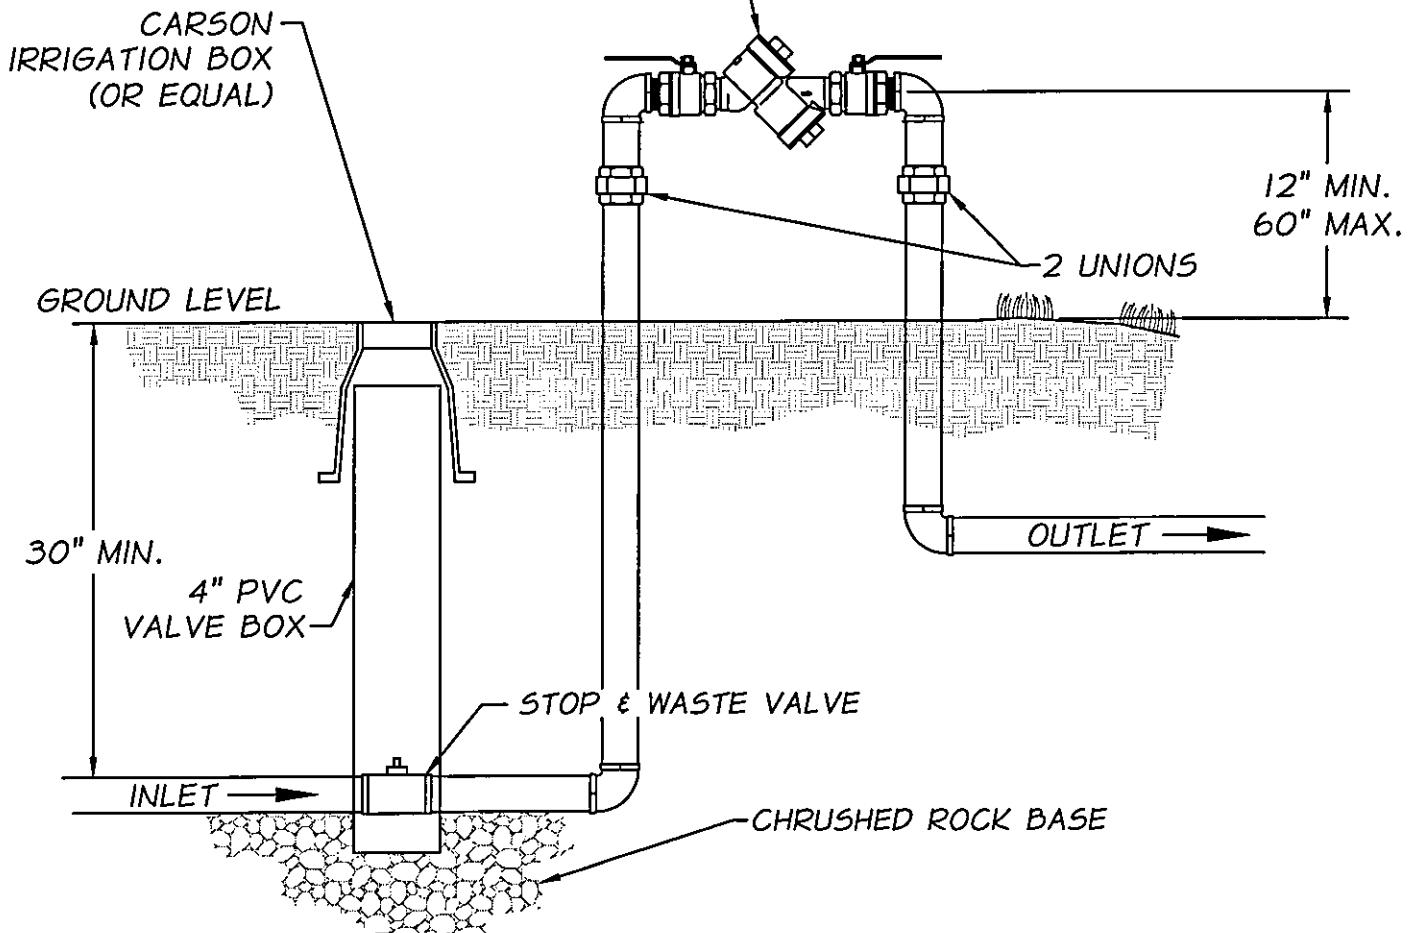

NOTES:

1. IT IS ADVISABLE TO REMOVE YOUR ASSEMBLY EVERY WINTER AT UNIONS AND STORE IN A WARM PLACE TO PREVENT DAMAGE TO THE ASSEMBLY FROM FREEZING.
2. IF SPRINKLER SYSTEM IS BLOWN OUT THROUGH THE BACKFLOW ASSEMBLY DAMAGE CAN OCCUR TO THE DISK AND THE ASSEMBLY CAN FAIL ITS ANNUAL TEST.
3. ADEQUATE SPACE MUST BE PROVIDED FOR MAINTENANCE, REPAIR AND TESTING.
4. NOTCH VALVE BOX AROUND INLET PIPE. DO NOT ALLOW VALVE BOX TO REST ON PIPE.

ABOVE GROUND INSTALLATION 3/4" AND 1" DOUBLE CHECK VALVE ASSEMBLY



APPROVED BY:	<u>Joe Stump</u>	<u>11-30-05</u>
Utilities Manager		DATE:
REVISION:	DESCRIPTION:	DATE:

BACKFLOW PROTECTION DETAIL

W-15

SHEET 1 OF 1