


* SEE TYPICAL ROADWAY SECTION FOR DIMENSIONS

SECTION B
0.33' THICK SIDEWALK SECTION
NTS

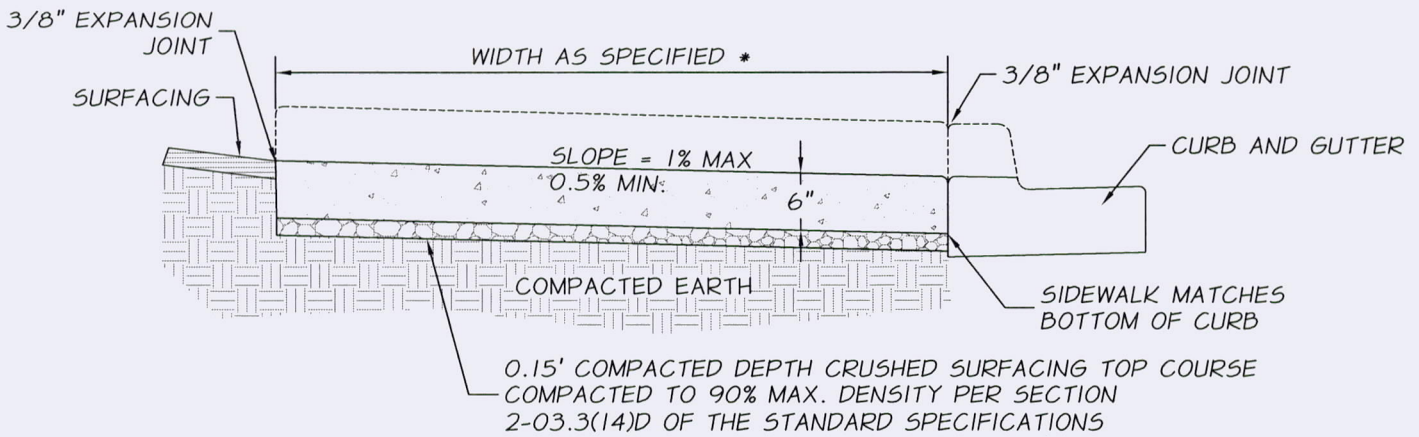

* SEE TYPICAL ROADWAY SECTION FOR DIMENSIONS

SECTION C
0.5' THICK SIDEWALK SECTION AT DRIVEWAYS
NTS

NOTES:

- 1) ANY SIDEWALK PANEL WITH A CROSS SLOPE GREATER THAN 2% SHALL BE REMOVED AND REPLACED.
- 2) FOR MOUNTABLE CURB AND GUTTER, CURB SIDEWALK SHALL BE A MINIMUM OF 0.5' THICK.
- 3) SEE YAKIMA COUNTY STANDARD PLAN S-3 FOR EXPANSION JOINT DETAILS.

CEMENT CONCRETE SIDEWALK SECTIONS



APPROVED BY: MA DATE: 3/10/2020
County Engineer:

REVISION:	DESCRIPTION:	DATE:

STANDARD PLAN
S-7
SHEET 2 OF 2